


# 4 Single Stage (On/Off) Heaters with Auto Ignition, 3Ph to remote SmartCom<sup>3</sup> SZ.

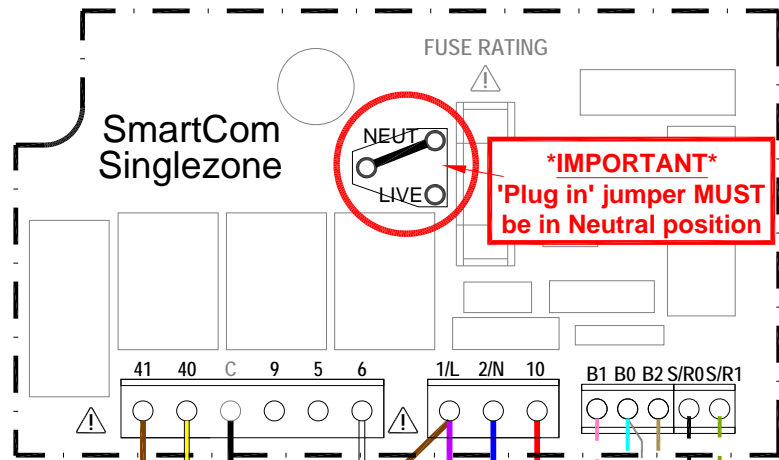

**NOTES:**


Controls cables min 0.75mm<sup>2</sup> cable for up to a distance of 200m.

**REMOTE SWITCH INPUTS**

should be connected by 6A mains  
Max length is 100m.  
Low voltage switching inputs to be normally open (closed circuit to enable).  
Connect to B0 & B1 for remote ON (ie BMS time control).  
Connect to B0 & B2 for remote OFF (ie door interlock. remote frost etc).  
\*The power supply is non-isolated, therefore all wiring to the control must be mains rated.

**REMOTE SENSOR(s)** may be placed at a max distance of 100m from the control unit, using screened 6A mains\* cable. Wiring should be kept separate from mains wiring to minimise noise pick up. Set within Engineers functions for remote sensor.

\*The power supply is non-isolated, therefore all wiring to the control must be mains rated.

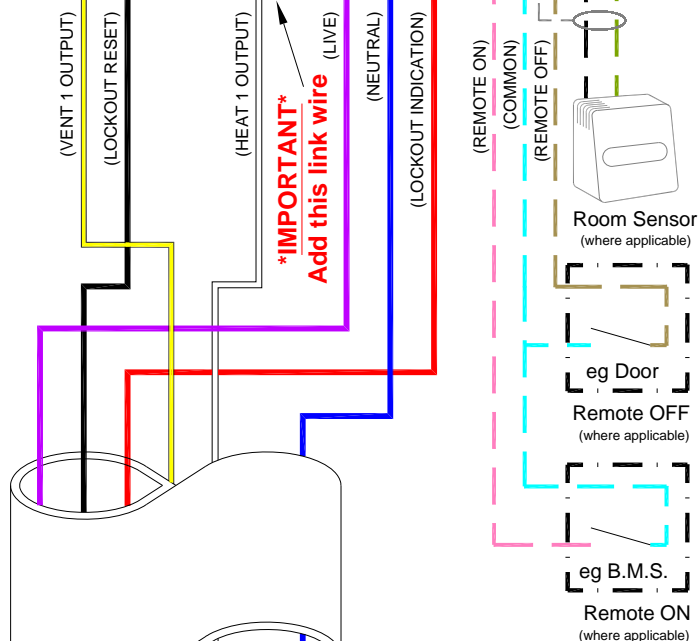

Non-interrupted mains supply must be present at the heater

